

PLUMBING ABBREVIATIONS

A	AIR	INV	INVERT
ACL	ABOVE CEILING LEVEL	IWH	INSTANTANEOUS WATER HEATER
AD	AREA DRAIN (EXPOSED TO RAIN)	JP	JOCKEY PUMP
AFF	ABOVE FINISHED FLOOR	2KS	KITCHEN SINK (2 COMPARTMENT)
AFR	ABOVE FIXTURE RIM	KS OR K	KITCHEN SINK
ARL	ABOVE ROOF LEVEL	LAV OR L	LAVATORY
BCL	BELOW CEILING LEVEL	LP	LOW PRESSURE
BCT	BELOW COUNTER TOP	LS	LEVEL SENSOR
BFL	BELOW FLOOR LEVEL	LWM	LAUNDRY WASHER MACHINE
BFP	BACKFLOW PREVENTER	M	METER
BLJ	BELOW JOISTS	MECH	MECHANICAL
BP	BOOSTER PUMP	MH	MANHOLE
BJU	BETWEEN JOISTS	MP	MEDIUM PRESSURE
BLR	BOILER (STEAM ONLY)	MR	MOP RECEPTOR
BWV	BACKWATER VALVE	MV	MIXING VALVE
C OR COND	CONDENSATE	N	NORTH
CD	CONDENSATE DRAIN	NG	NATURAL GAS
CF	CHEMICAL FEED	O	OXYGEN
CHWS/R	CHILLED WATER SUPPLY/RETURN	O/H	OVERHEAD
CP	CIRCULATOR PUMP	OVF	OVERFLOW
CS	CLINIC SINK	PI	PRESSURE INDICATOR
DCW/HW	DOMESTIC COLD WATER/HOT WATER (POTABLE)	PRV	PRESSURE REDUCING VALVE
DHWS/R	DOMESTIC HOT WATER SUPPLY/RETURN	PW	PURE WATER
DD	DECK DRAIN	RD	ROOF DRAIN
DF	DRINKING FOUNTAIN	RH	RADIANT HEATER
DFU	DRAIN FIXTURE UNIT	RM	ROOM
DP	DUPLEX PUMP	RO	REVERSE OSMOSIS
DR	DOOR	RTC	RUNNING TRAP WITH CLEANOUT
DSTP	DRY STANDPIPE	RV	RELIEF VALVE
DV	DRY VENT	RWC	RAIN WATER CONDUCTOR
DVC	DRY VENT CONNECTION (ABOVE FIXTURE RIM LEVEL)	S	SOUTH OR STEAM
DWH	DOMESTIC WATER HEATER (POTABLE)	SAN	SANITARY/WASTE
DWM	DISH WASHER MACHINE	SF	SQUARE FOOT
E	EAST	SFU	SUPPLY FIXTURE UNIT
(E)	EXISTING	SH OR S	SHOWER
EL	ELEVATION (STRUCTURAL HEIGHT)	SLV	SOLENOID VALVE
EW	EYE WASH	SP	SUMP PUMP OR SEWAGE PUMP
EWC	ELECTRIC WATER COOLER	SS	SERVICE SINK OR LAUNDRY SINK OR STAINLESS STEEL
EXP	EXPANSION TANK	ST	STORM WATER
FAI	FRESH AIR INTAKE	STK	STACK
FCO	FLOOR CLEANOUT	STM	STEAM
FCW	FILTERED COLD WATER	SV	SAFETY VALVE
FD	FLOOR DRAIN (NOT EXPOSED TO RAIN)	TD	TRENCH DRAIN OR THERMO DYNAMIC
FHC	FIRE HOSE CONNECTION	TEA	THERMAL EXPANSION ABSORBER
FND	FUNNEL DRAIN	TI	TEMPERATURE INDICATOR
FP	FIRE PUMP	TP	TRAP PRIMER
FS	FLOOR SINK	TS	TEMPERATURE SENSOR
FW	FIRE WATER	T	TUB OR TRAP
FWG	FOOD WASTE GRINDER	U/G	UNDERGROUND
FT	FLOAT & THERMOSTATIC	UR	URINAL
FU	FIXTURE UNIT	V	VACUUM
GHC	GARDEN HOSE CONNECTION	VB	VACUUM BREAKER
GI	GREASE INTERCEPTOR	VBD	VALVE BOX AND DRAIN
GD	GUTTER DRAIN	VR	VENT RISER (DRY VENT)
QWM	GLASS WASHER MACHINE	VST	VENT STACK
HCO	HORIZONTAL CLEANOUT	VT	VENT
HI	HAIR INTERCEPTOR	VTR	VENT THROUGH ROOF
HP	HIGH PRESSURE	W	WEST
HS	HAND SINK	WBP	WATER BOOSTER PUMP
HWG	HOT WATER GENERATOR (HYDRONIC SYSTEM)	WC OR W	WATER CLOSET
HWS/R	HOT WATER SUPPLY/RETURN (HYDRONIC SYSTEM)	WCO	WALL CLEANOUT
IB	INVERTED BUCKET	WHA	WATER HAMMER ARRESTOR
IPS	IRON PIPE SIZE	WP	WHIRLPOOL
IKS	ISLAND KITCHEN SINK	WTSP	WET STANDPIPE
IW	INDIRECT WASTE	YV	YOKE VENT
IL	INTERMEDIATE LANDING	YVR	YOKE VENT RISER
		ZV	ZONE VALVE

PLUMBING LEGEND

	BUTTERFLY VALVE
	ANGLE GLOBE VALVE
	SAFETY OR RELIEF VALVE
	GATE VALVE OR VALVE IN GENERAL
	BALL VALVE
	GLOBE VALVE
	BALANCING VALVE
	PRESSURE REDUCING VALVE (SPRING LOADED)
	PRESSURE REDUCING VALVE (PILOT TYPE)
	FLOOR/DECK OR AREA DRAIN
	FUNNEL DRAIN
	ROOF DRAIN
	90 DEG. ELBOW FAR FLOW
	90 DEG. ELBOW NEAR FLOW
	TEE NEAR FLOW
	TEE FAR FLOW
	PLUG VALVE
	BACKFLOW PREVENTER
	GARDEN HOSE/WASHDOWN OR FIRE DEP. HOSE CONNECTION
	COLD WATER
	DOMESTIC HOT WATER
	DOMESTIC HOT WATER RETURN
	SANITARY SEWER – UNDER GROUND/SLAB/FLOOR
	STORM WATER
	VENT PIPING
	FIRE PROTECTION PIPE
	GAS PIPE
	PIPE CLEANOUT (HORIZONTAL OR WALL)
	PIPE CLEANOUT (GRADE OR FLOOR)
	FUNNEL DRAIN
	REDUCER
	FLOOR DRAIN, AREA DRAIN OR FLOOR SINK
	TEMPERATURE INDICATOR
	PRESSURE INDICATOR
	VALVE BOX AND DRAIN
	KITCHEN SINK WITH DISHWASHER MACHINE
	TARGET POINTING TO CONNECTION BETWEEN EXISTING AND NEW OR TO THE EXTENT OF DEMOLITION

PLUMBING NOTES


- THE PRIORITY OF ILLUSTRATED PIPING ON PLANS IS TO SHOW CLEARLY THE SERVICE FROM ONE POINT TO ANOTHER WITH MINIMUM OR NO OBSTRUCTION BY THE BACKGROUND. PHYSICALLY THE PIPE RUNS ARE INSTALLED INSIDE WALLS, ABOVE CEILING OR WITHIN PIPE CHASES. ARCHITECT SHALL REVIEW AND APPROVE THE FINAL LOCATION OF PLUMBING COMPONENTS WHERE THEY AFFECT ARCHITECTURAL FINISHES.
- UNLESS THE INSTALLATION IS DIMENSIONED, DRAWINGS ARE DIAGRAMMATIC AND INDICATING THE GENERAL ARRANGEMENT OF PIPING NETWORK TO BE PERFORMED. ALL MINOR DETAILS ARE NOT SHOWN ON PLANS OR SPECIFIED, BUT NECESSARY FOR THE PROPER INSTALLATION AND OPERATION OF ALL SYSTEMS, SHALL BE PROVIDED BY THE CONTRACTOR WITH NO ADDITIONAL CHARGES TO THE OWNER.
- DOMESTIC WATER SERVICE TO FAUCETS (COLD OR COLD AND HOT) SHALL BE 1/2" PIPE SIZE UNLESS NOTED OTHERWISE. ALL FIXTURES AND EQUIPMENT SHALL HAVE ONE FULL PORT AND PIPE SIZE SHUTOFF VALVE PER PIPE CONNECTION FOR MAINTENANCE PURPOSE. ALL DOMESTIC SERVICES SHALL BE INSULATED.
- PLUMBING CONTRACTOR SHALL CHECK AND VERIFY ALL MEASUREMENTS, ILLUSTRATED PIPING LOCATIONS AND AREAS AFFECTED BY STRUCTURAL, MECHANICAL AND ELECTRICAL CONDITIONS PRIOR TO PRECEDING WITH DEMOLITION AND/OR NEW WORK. ANY CONFLICT OR DISCREPANCY BETWEEN SUBMITTED DRAWINGS AND FIELD CONDITION SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEERS WITHOUT DELAY.
- AVOID INSTALLING WATER SERVICE PIPE IN EXTERNAL WALL DUE TO FREEZING CONDITION. (ELECTRICAL HEAT TRACE FOR PIPING IS EXPENSIVE AND NOT RELIABLE, SHALL BE CONSIDERED ONLY AS A LAST RESOURCE.) INSULATION ON WATER PIPE DOES NOT PREVENT FREEZING, IT ONLY EXTENDS THE SOLIDIFICATION TIME. WHERE WATER SERVICE IS NEAR EXTERIOR WALL, PROVIDE STUDDED PARTITION FLUSH TO THE EXTERIOR WALL FOR PIPE INSTALLATION. APPLY INSULATION ON THE EXTERIOR WALL SIDE OF THE PARTITION WITH NO INSULATION ON THE ROOM SIDE. ALL SANITARY PIPING LAID BELOW SURFACE OF FREEZING TEMPERATURE SHALL HAVE MINIMUM 3'-0" COVER.


PLUMBING SHEET NOTES


- EXISTING SANITARY LINE TO STREET TO REMAIN.
- NEW SANITARY LINE RUN UNDER SLAB. CUT PATCH AND REPAIR SLAB.
- CONNECT NEW SANITARY LINE TO EXISTING LINE. VERIFY EXACT LOCATION IN FIELD.
- EXISTING INCOMING WATER SERVICE. CONECT NEW WATER SERVICE TO EXISTING INCOMING LINE. PROVIDE NEW SHUT OFF AND BACKFLOW PREVENTION DEVICE WATTS 909.
- HVAC EQUIPMENT BY MC
- GAS LINEUP TO GAS FIRED ROOFTOP UNIT WITH GAS SHUT OFF VALVE AND 6" SEDIMENT TRAP.
- GAS LINE DOWN TO COMMERCIAL FOOD SERVICE EQUIPMENT UNDER TYPE 1 HOOD. PROVIDE SOLENOID SHUT OFF VALVE INTERLOCKED WITH HOOD FIRE SUPPRESSION SYSTEM AND MANUAL TRIP.
- GAS CONNECTION TO COMMERCIAL FOOD SERVICE EQUIPMENT. CONNECTION PER EQUIPMENT MFG. REQUIREMENTS. PROVIDE SHUT OFF VALVE, FLEX LINE AND QUICK DISCONNECT.
- PVC VENT AND AIR INTAKE FOR HOT WATER HEATER UP THRU ROOF WITH MFG. TERMINATION KIT FINAL TERMINATION OF PIPES PER MFG. REQUIREMENTS
- GAS LINE DOWN TO GAS FIRED HOT WATER HEATER WITH GAS COCK AND 6" SEDIMENT TRAP.
- INCOMING GAS SERVICE PER LOCAL GAS COMPANY REQUIREMENTS GAS METER PER LOCAL GAS COMPANY
- NEW SUMP PUMP IN NEW BASIN TO REPLACE EXISTING SUMP SYSTEM.
- PROVIDE WATTS SERIES 007 1/2" BACK FLOW PREVENTION DEVICE.

PIPE SPECIFICATION						
SYSTEM	MATERIAL	JOINTS	NOTES	INSULATION TYPE	INSULATION THICKNESS	NOTES
DOMESTIC WATER ABOVE GRADE	TYPE L COPPER	SOLDERED OR THREADED		RIGID FIBERGLASS	1"	PVC FITTING COVERS, EXPOSED PIPING 24 GAGE SS JACKETED INCLUDING FITTINGS.
WASTE, DRAIN & VENT BELOW GRADE	CAST IRON	HUB & SPIGOT PACKED WITH LEAD & OAKUM				
WASTE & DRAIN ABOVE GRADE 2" AND SMALLER	TYPE DWV COPPER	SOLDERED				
WASTE & DRAIN ABOVE GRADE 2½" AND LARGER	CAST IRON	HUBLESS	HUSKEY 4000-SD COUPLING REQUIRED			
DRY VENT PIPE 2" AND SMALLER ABOVE GRADE	TYPE DWV COPPER	SOLDERED				
DRY VENT PIPE 2½" AND LARGER ABOVE GRADE	CAST IRON	HUBLESS	HUSKEY 4000-SD COUPLING REQUIRED			


PLUMBING FIXTURE CONNECTION SCHEDULE							
FIXTURE TYPE	ABBREV	FIX. UNIT VALUE	CONNECTION SIZES				REMARKS
			(TRAP) SAN	VENT	HW	CW	
WATER CLOSET	WC	4	4	2	–	1/2	FLUSH TANK
URINAL	UR	3	3	1–1/2	–	3/4"	
LAVATORY	LAV	1	1–1/4	1–1/4	1/2	1/2	
MOP RECEPTOR	MR	3	3	3	3/4	3/4	
SINK	SK	2	1–1/2	1–1/2	1/2	1/2	
FLOOR SINK	FS	3	4	2	–	–	
FLOOR DRAIN	FD	2	4	2	–	–	WITH TRAP PRIMER

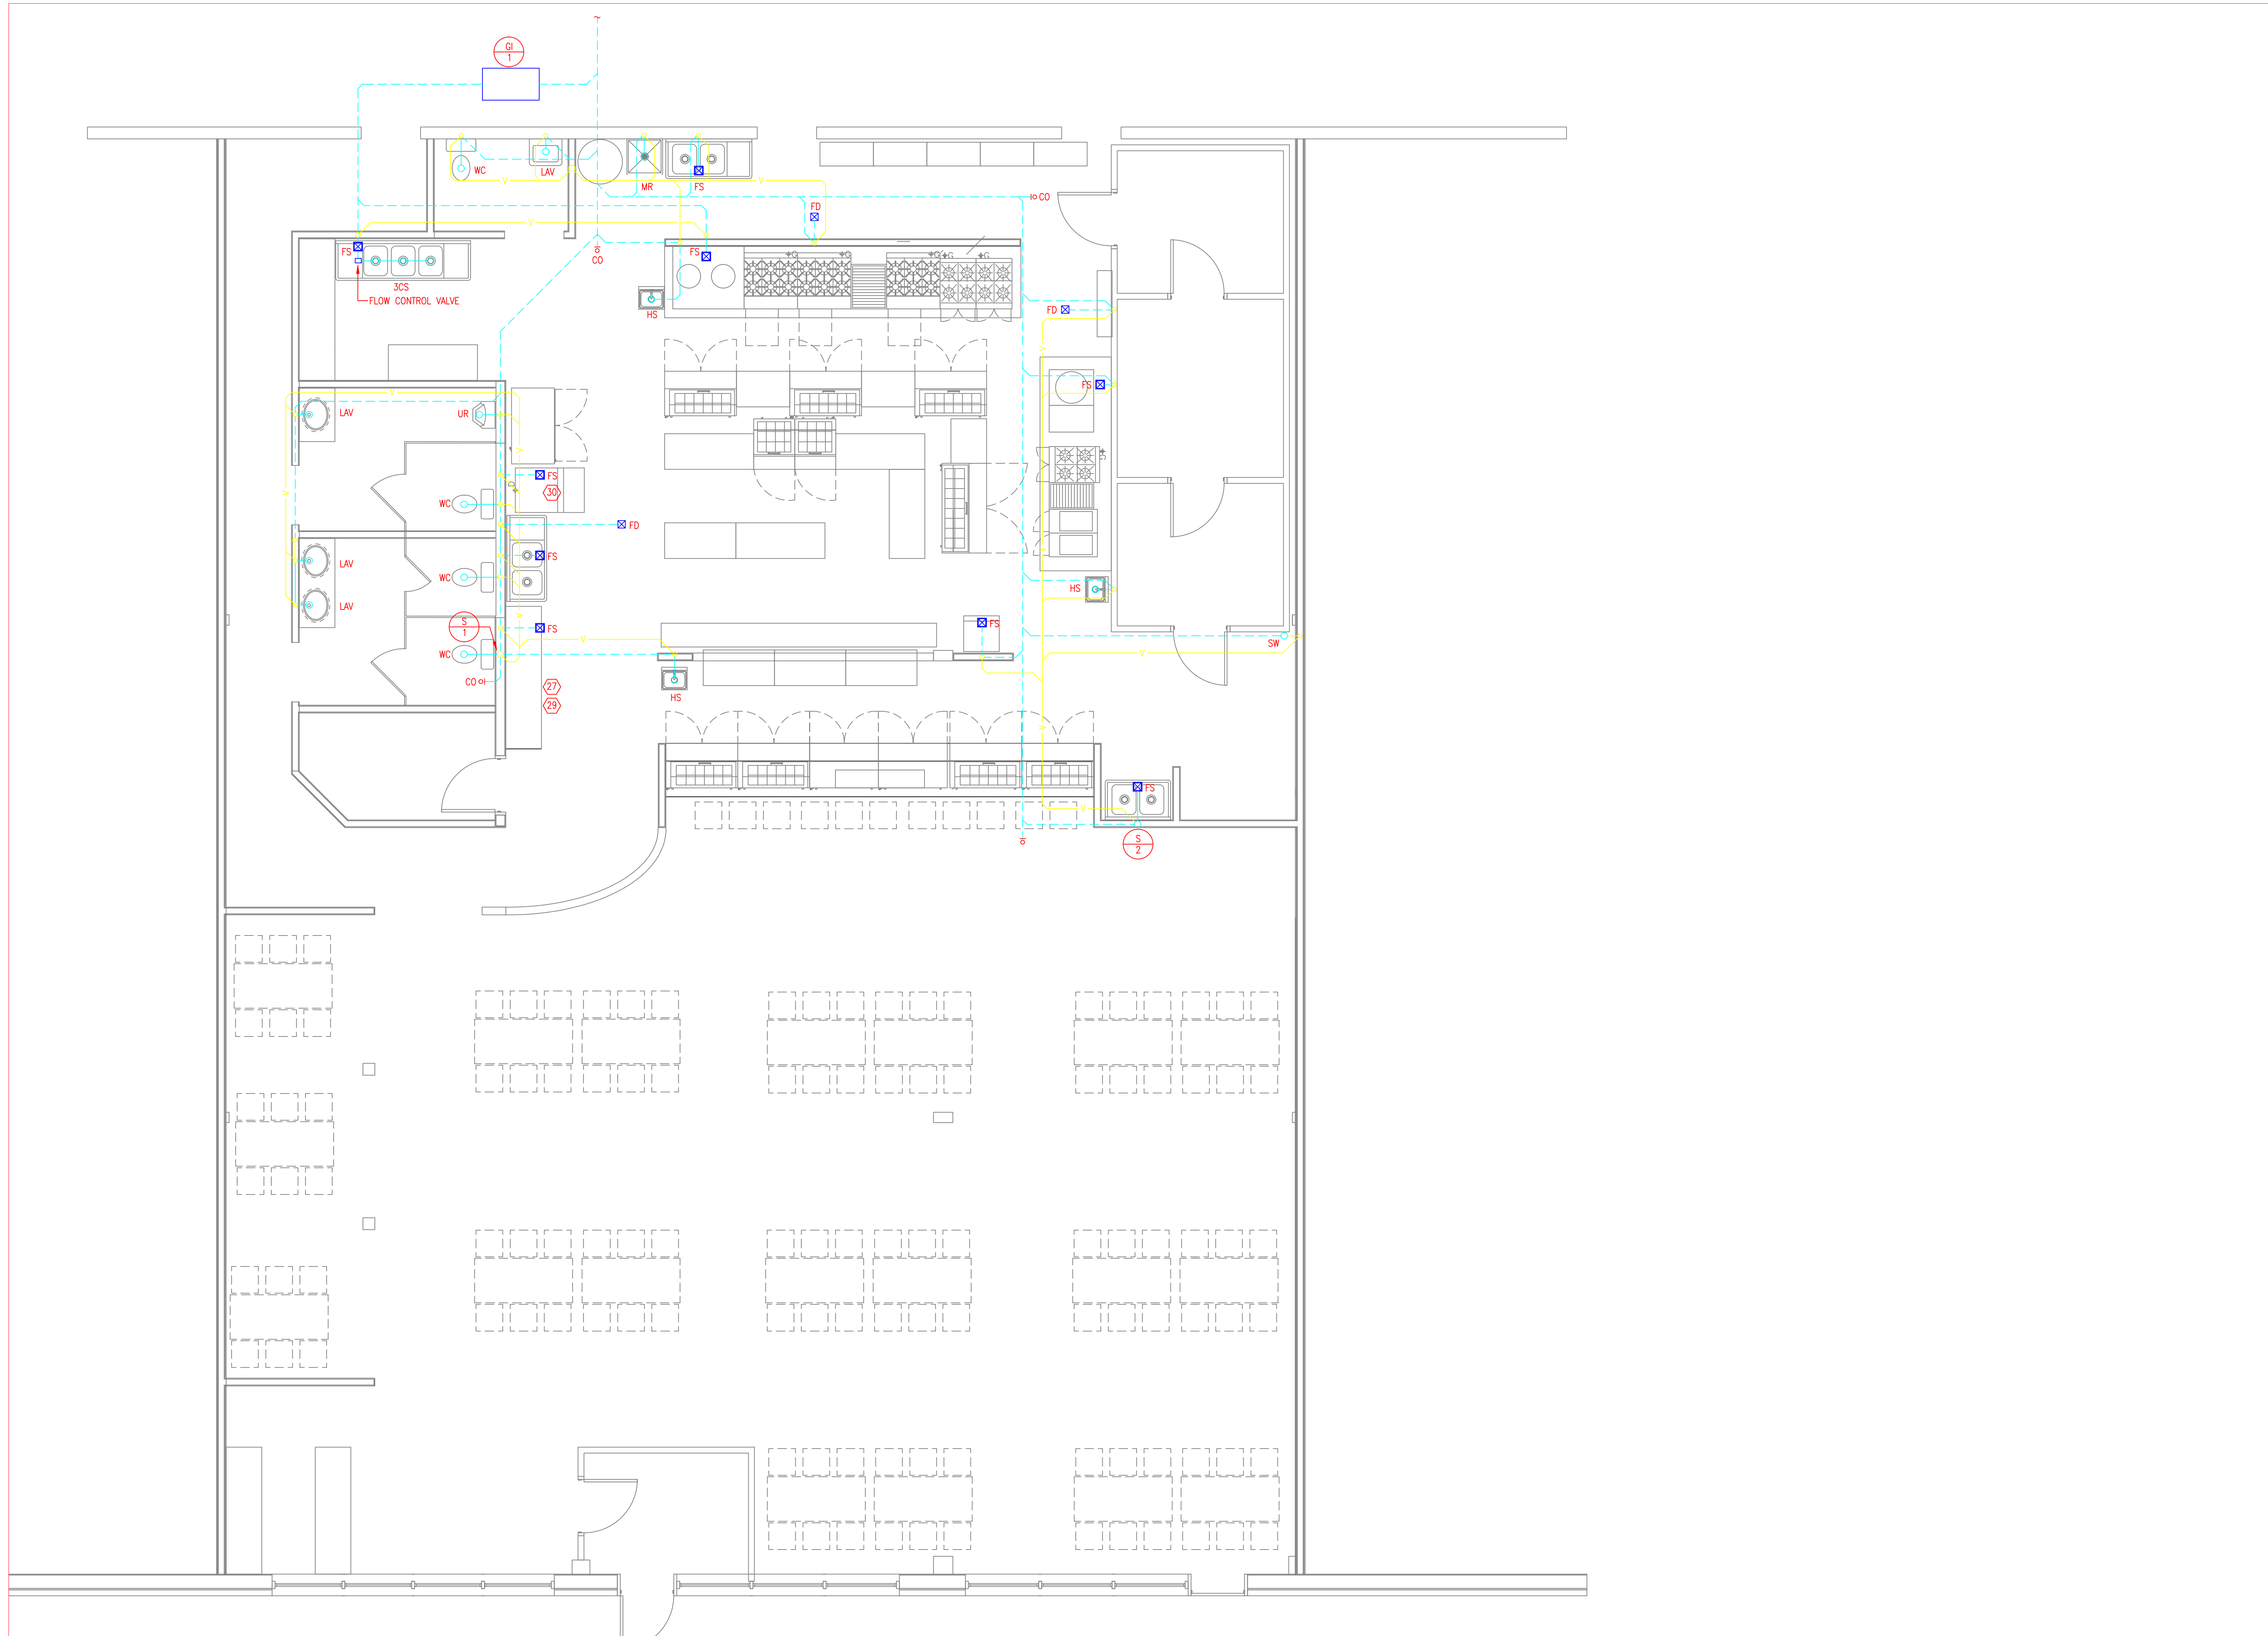

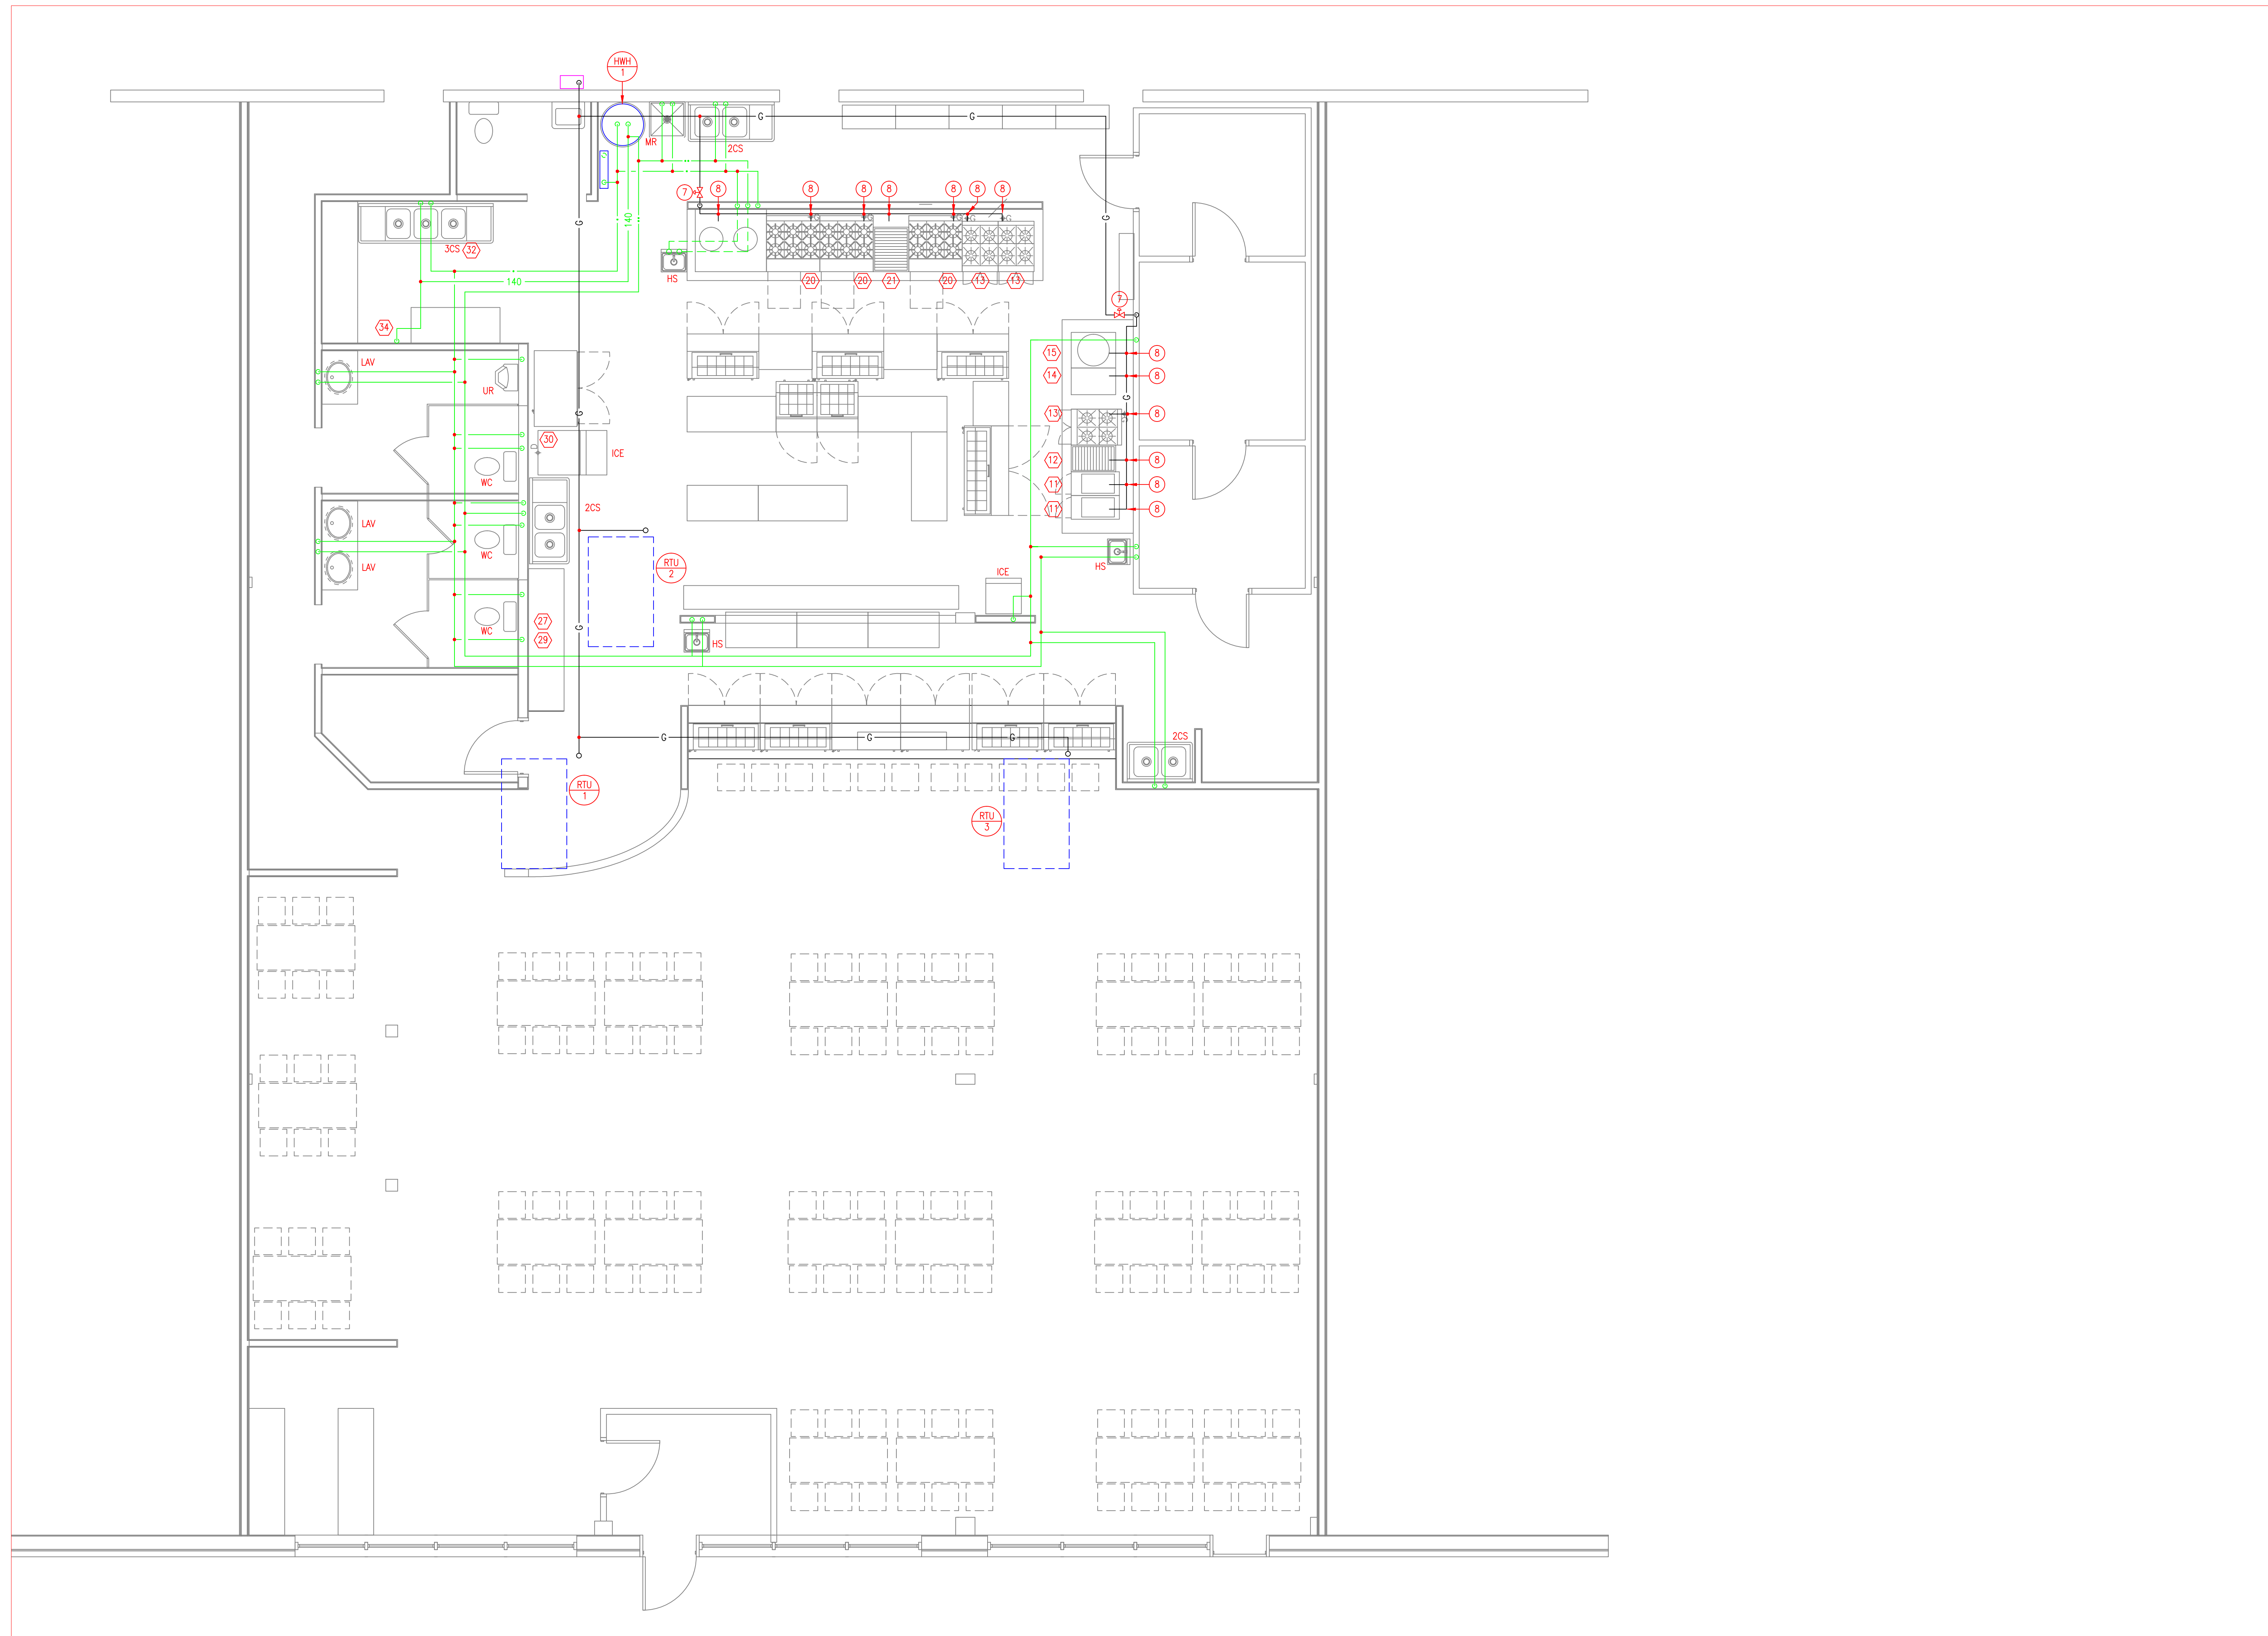


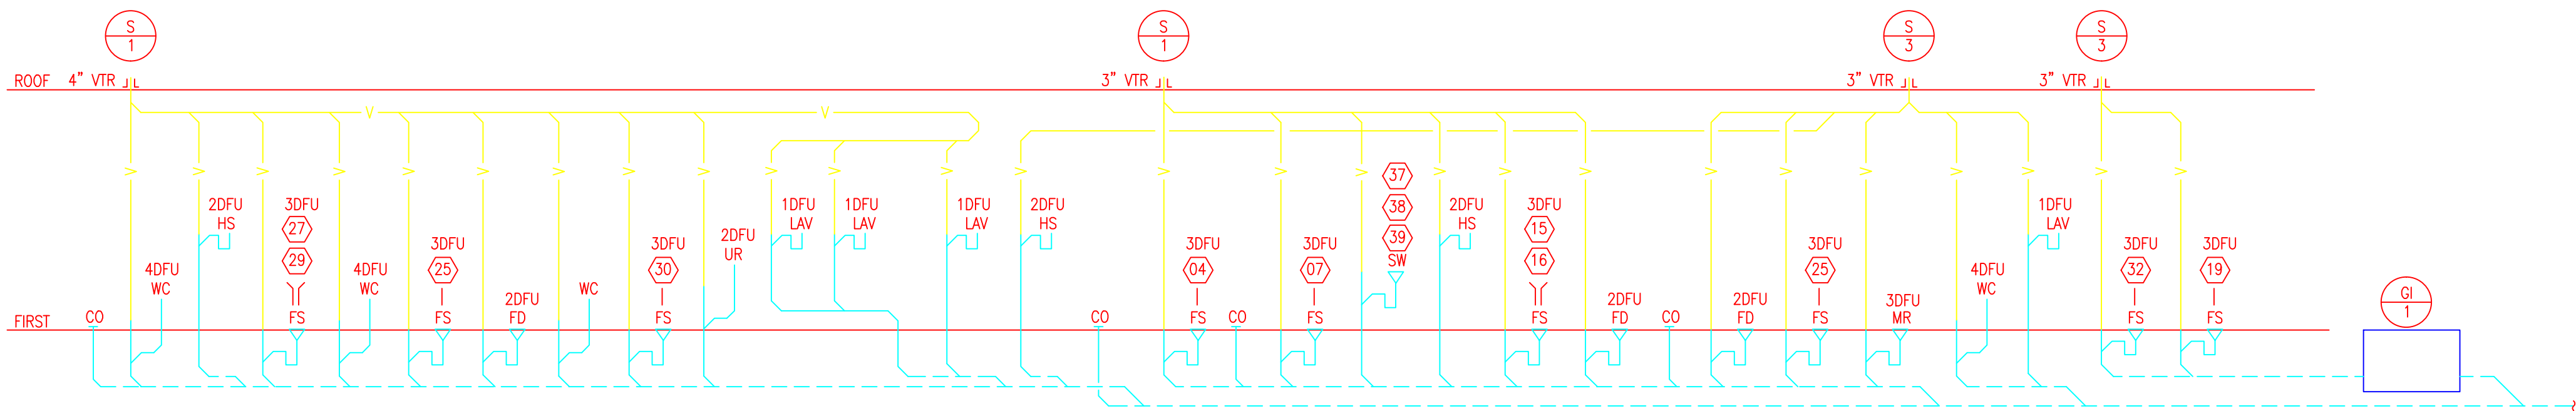


SANITARY RISER DIAGRAM
NTS
PIPING TO BE SLOPED AT 1/8" PER FT

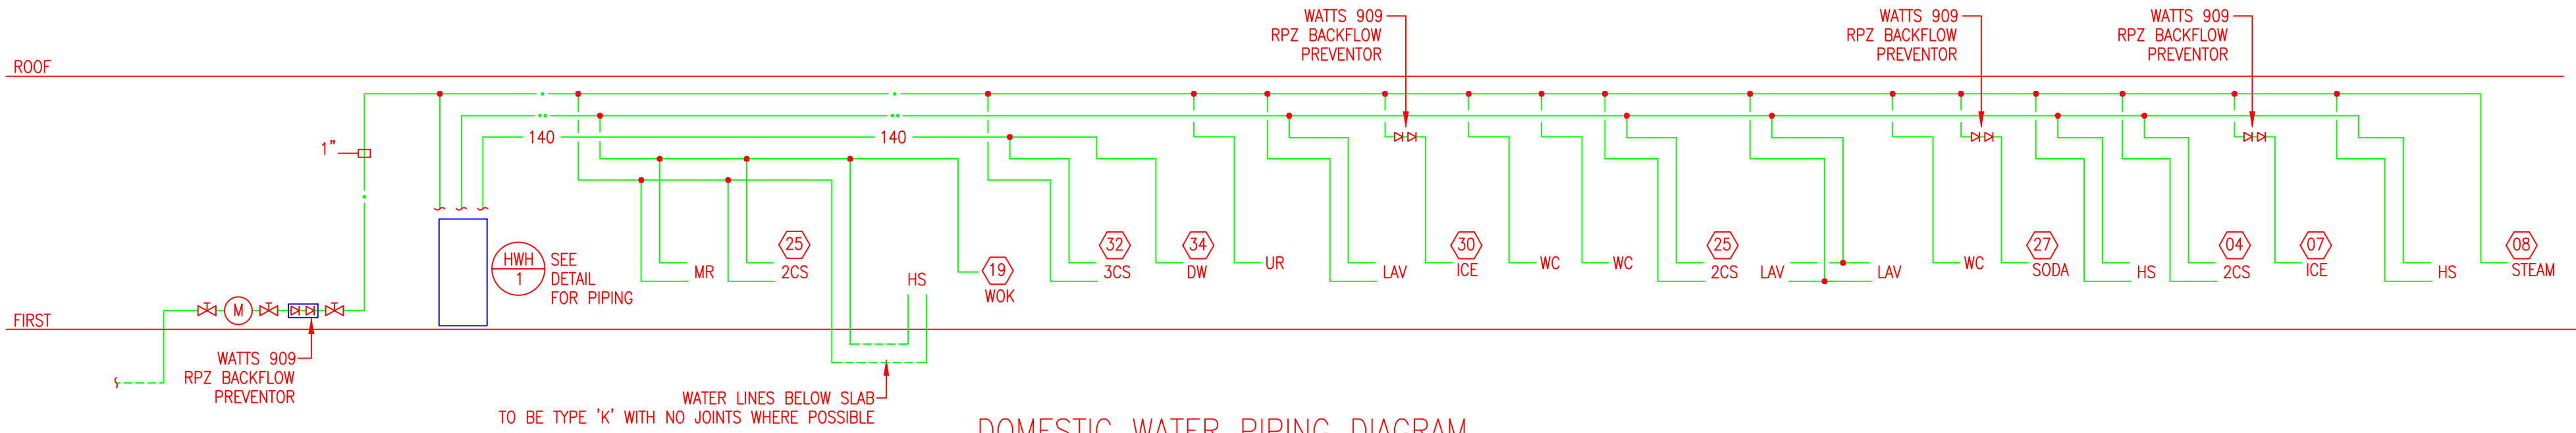

DOMESTIC WATER PIPING DIAGRAM
NTS
TO BE TYPE 'K' WITH NO JOINTS WHERE POSSIBLE

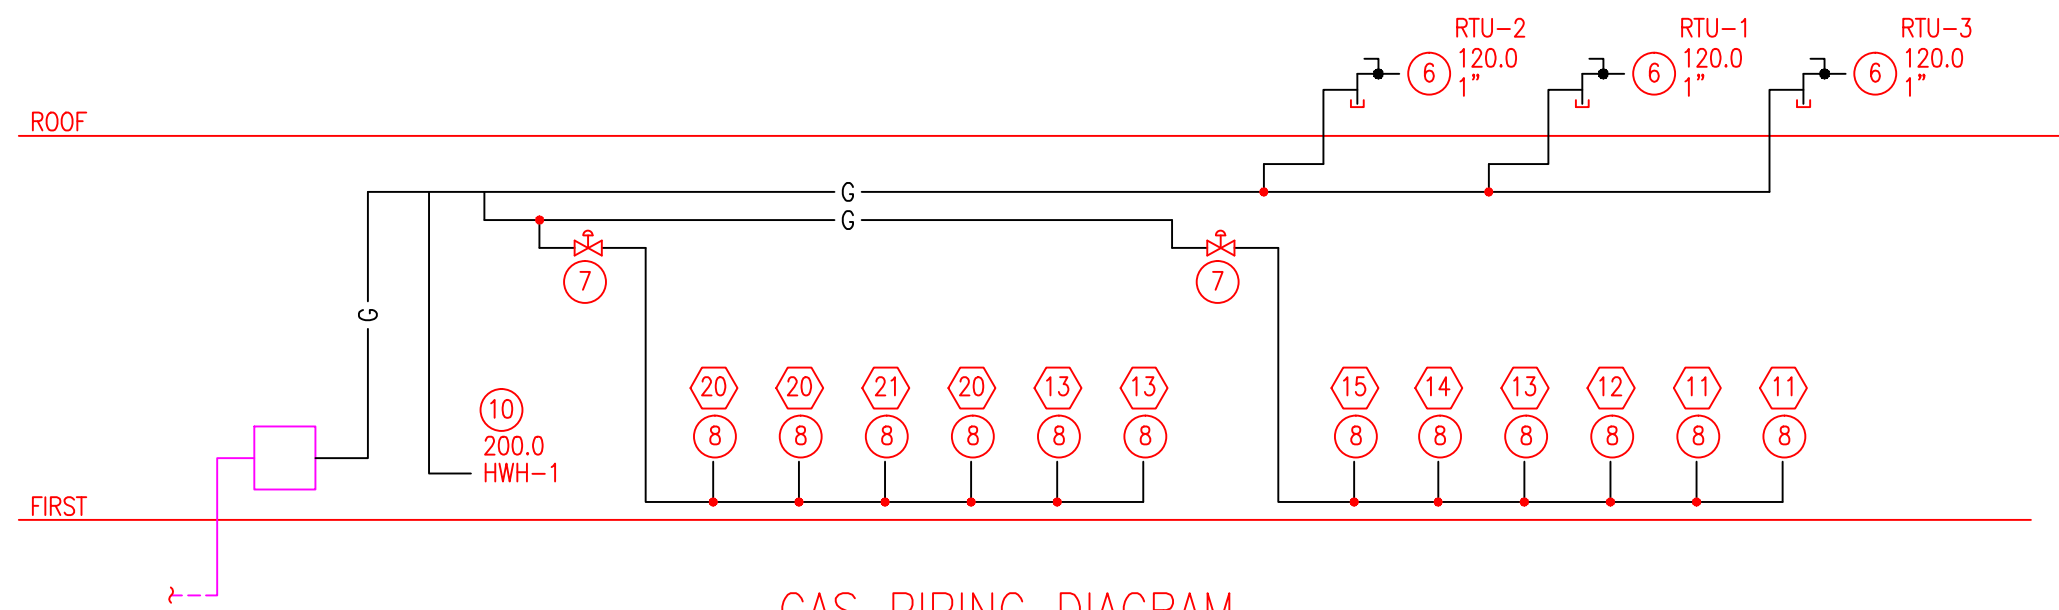


GAS PIPING DIAGRAM
NTS
GAS PIPE SIZE BASED ON IFGC 2009 TABLE 402.4(1)
125' DEVELOPED LENGTH

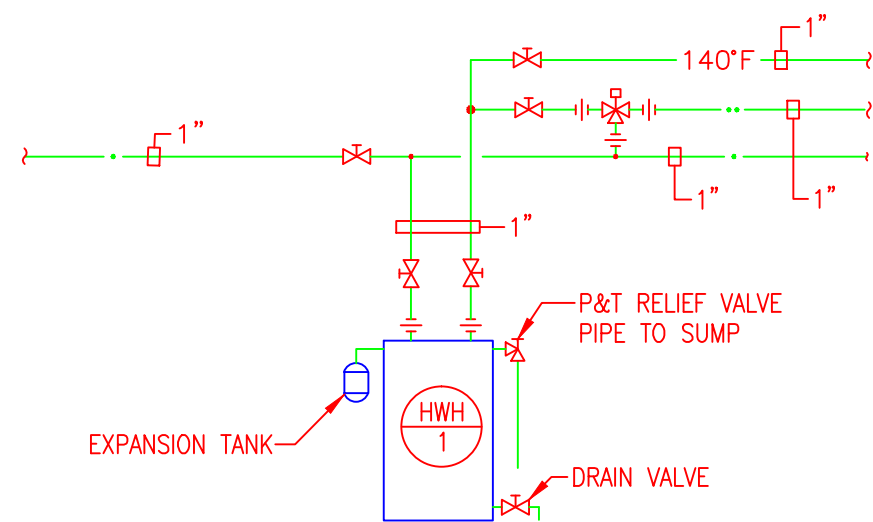


DOMESTIC HOT WATER HEATER PIPING DETAIL
NTS


HWH-1
ULTRA HIGH EFF. GAS FIRED HOT WATER HEATER
BRADFORD WHITE EF-100T-199E
100 GALLON STORAGE 199,900 BTH/HR HEATING CAPACITY
309 GALLON FIRST HR DELIVERY AND 239 GALLON RECOVERY RATE AT 100% RISE
WITH P&T VALVE, DRAIN VALVE AND EXPANSION TANK

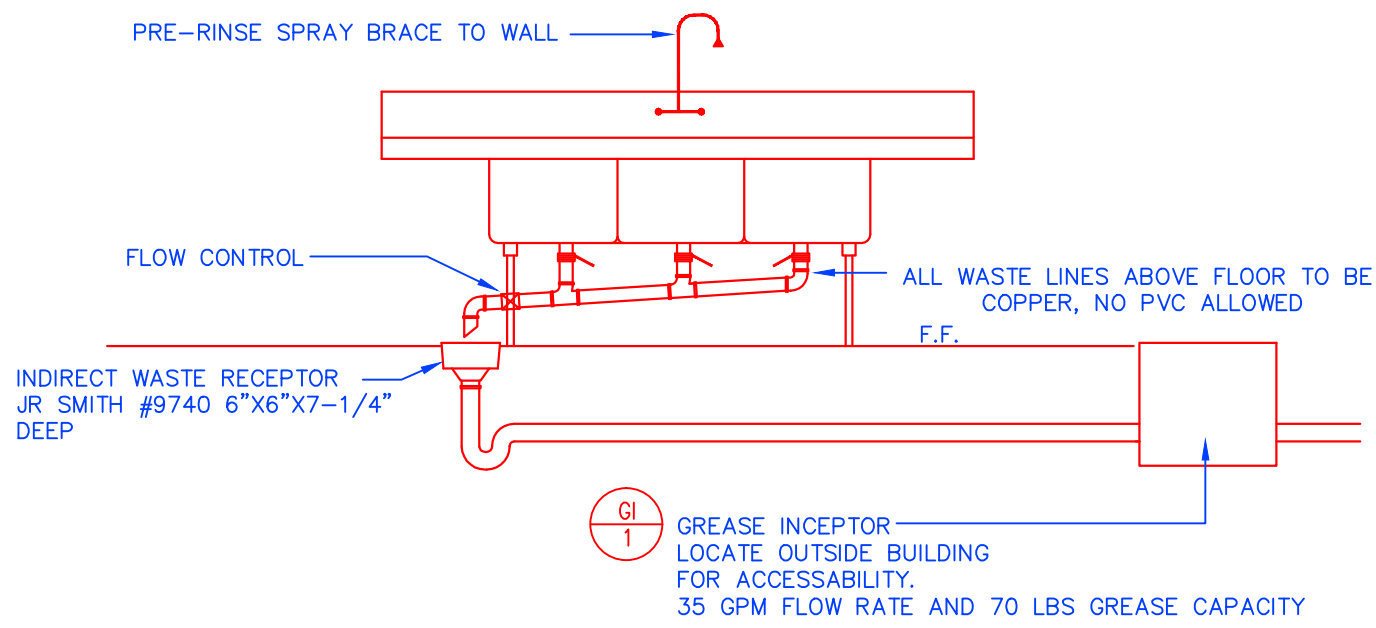

COMPARTMENT SINK INSTALL DETAIL
NO SCALE

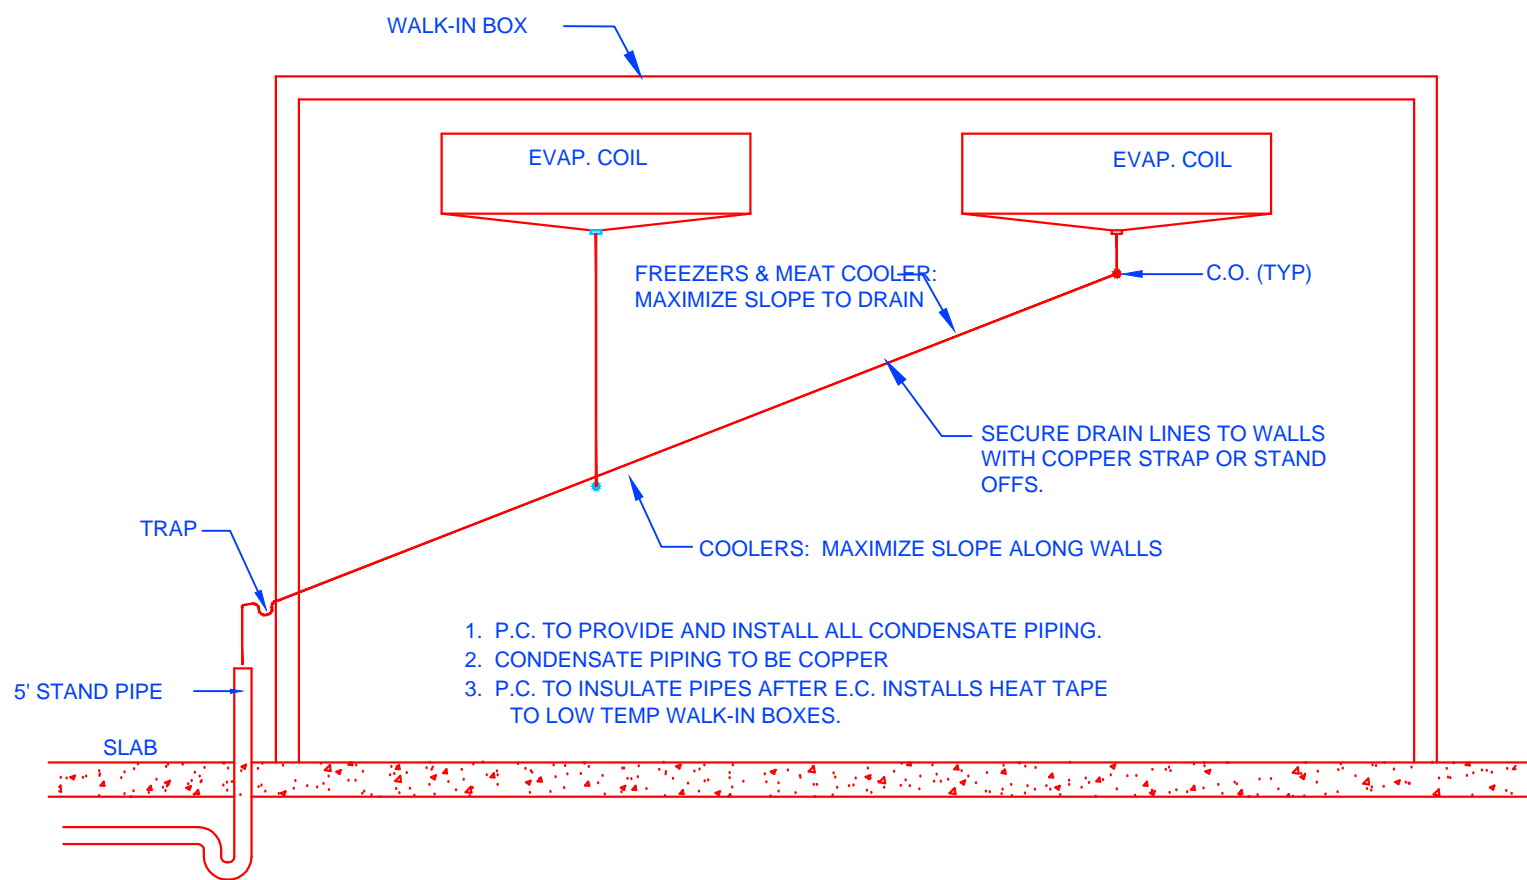

EVAPORATOR COIL CONDENSATE PIPING
NO SCALE

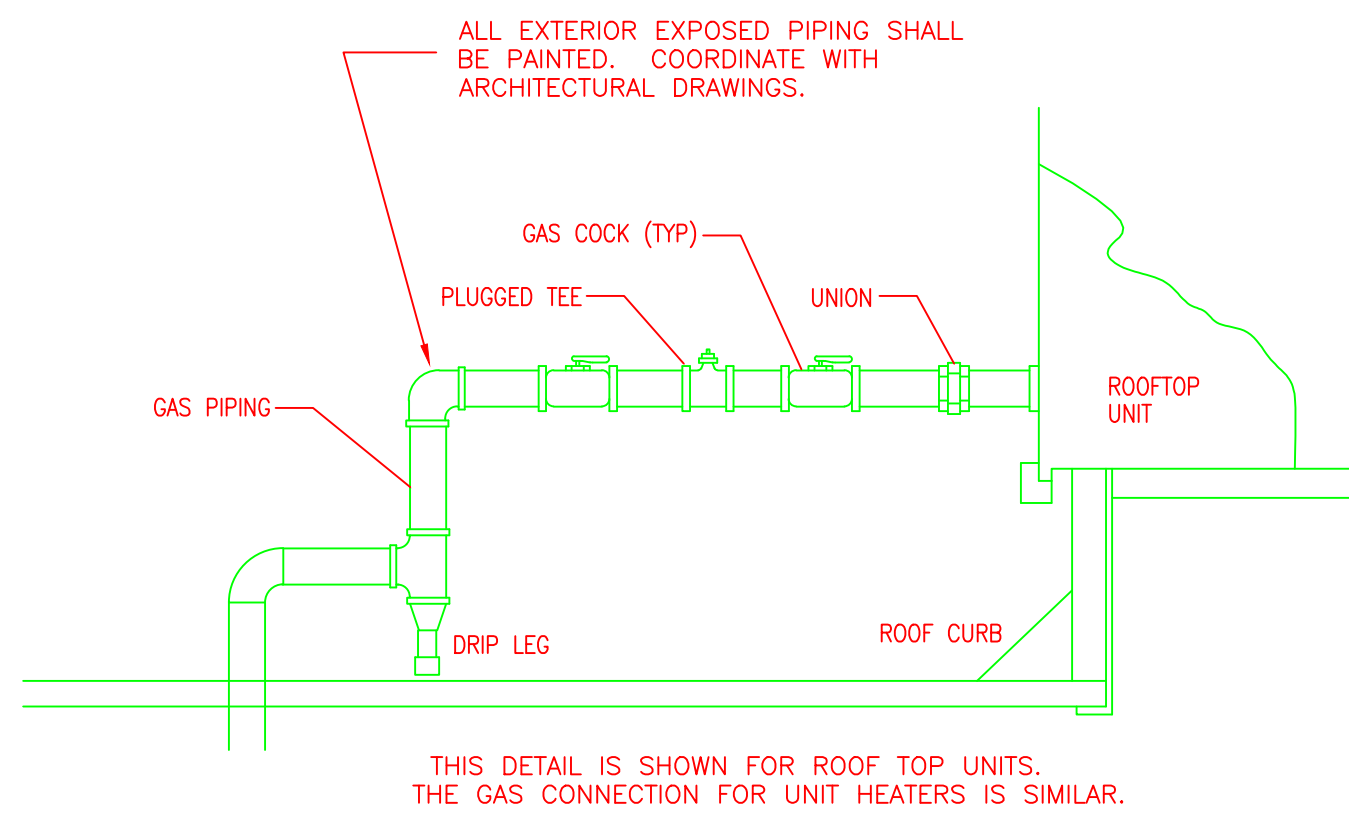

GAS PIPING CONNECTION DETAIL
NO SCALE

GENERAL HVAC NOTES

1. SCOPE OF WORK
- A. THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK, MATERIALS, AND LABOR TO SATISFY A COMPLETE WORKING SYSTEM WHETHER SPECIFIED OR IMPLIED.

B. ALL WORK IS TO BE PERFORMED IN STRICT COMPLIANCE WITH THE 2009 INTERNATIONAL MECHANICAL CODE, ALL STATE AND LOCAL CODES AND ALL OTHER REGULATIONS GOVERNING WORK OF THIS NATURE.

C. THE CONTRACTOR SHALL, BEFORE SUBMITTING ANY PROPOSAL, EXAMINE THE PROPOSED SITE AND SHALL DETERMINE FOR HIMSELF THE CONDITIONS THAT MAY EFFECT THE WORK. NO ALLOWANCE SHALL BE MADE IF THE CONTRACTOR FAILS TO MAKE SUCH EXAMINATIONS.

D. ALL EQUIPMENT AND MATERIALS SHALL BE AS SPECIFIED OR "APPROVED EQUAL" BY THE ENGINEER OR ARCHITECT.
2. PERMITS
- A. THE CONTRACTOR SHALL SECURE ALL PERMITS OR APPLICATIONS AND PAY ANY AND ALL FEES.
3. SHOP DRAWINGS
- A. SUBMIT MATERIAL LIST AND SHOP DRAWINGS FOR MAJOR EQUIPMENT TO THE ACHITECT/ENGINEER FOR APPROVAL. THE CONTRACTOR SHALL SUBMIT FIVE SETS OF SHOP DRAWINGS AND THEY SHALL BE CLEARLY LABELED.
4. FLEXIBLE TYPE DUCT
- A. SHALL BE OF TWO ELEMENT SPIRAL CONSTRUCTION COMPOSED OF A CORROSION RESISTANT METAL SUPPORTING SPIRAL AND COATED FABRIC WITH A MINERIAL BASE. FLEXIBLE DUCT CONNECTORS SHALL BE LISTED BY U.L., CLASS 1 DUCTS, AND SHALL HAVE A FLAME SPREAD RATING NOT EXCEEDING 25 AND A SMOKE DEVELOPED RATING NOT EXCEEDING 50.

B. USE OF FLEXIBLE DUCTWORK SHALL BE LIMITED TO NO MORE THAN 14 LINEAR FEET PER RUN.

C. CONTRACTOR SHALL BE CAREFUL SO AS NOT TO KINK OR COLLAPSE FLEXIBLE DUCT.
5. REFRIGERANT PIPING
- A. CONTRACTOR SHALL PROVIDE AND INSTALL REFRIGERANT PIPING IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND IN SUCH A WAY AS TO BE INCONSPICIOUS AND FREE FROM ANY POSSIBLE CONDENSATION. INSULATE REFRIGERANT LINES WITH ARMOURFLEX TYPE INSULATION.

B. SHALL BE TYPE "K" COPPER TUBING, WITH WROUGHT COPPER SOLDER TYPE FITTINGS SUITABLE FOR CONNECTION WITH SILVER SOLDER.
6. DUCTWORK
- A. THE DUCTWORK SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE "SMACNA" APPLICABLE MANUALS. ALL DUCTWORK SHALL BE THE LOW VELOCITY TYPE, UNLESS SPECIFIED OTHERWISE.

B. CONTRACTOR SHALL PROVIDE AND INSTALL APPROVED FIRE DAMPERS AND ACCESS PANELS IN ANY AND ALL DUCTWORK WHICH PENETRATES A HORIZONTAL OR VERTICAL FIRE PARTITION, OR AS OTHERWISE SHOWN ON DRAWINGS.

C. ALL BRANCH DUCTS TO HAVE VOLUME DAMPERS.

D. SMOOTH TURN RADIUS DUCTWORK OR TURNING VANES SHALL BE USED THROUGHOUT WHERE FLOW EXCEEDS 150 CFM.

E. ALL DUCT JOINTS TO BE SEALED IN ACCORDANCE WITH "SMACNA" STANDARDS AND ACCEPTED GOOD PRACTICE.

F. ALL DUCT DIMENSIONS SHOWN ARE NET INSIDE VALUES. DIMENSIONS MAY BE CHANGED SO LONG AS THE NET FREE FACE AREA IS MAINTAINED.

G. ALL CONCEALED DUCTWORK SHALL BE INSULATED WITH 1-1/2" FIBERGLASS INSULATING BLANKET WITH ALUMINUM FOIL FACING.

H. ALL SUPPLY AND RETURN DUCTWORK 15 FEET DOWNSTREAM OF THE HVAC UNIT SHALL BE INTERNALLY LINED WITH A 1/2" ACOUSTICAL DUCT LINER.

7. DRAINAGE PIPING (CONDENSATE)
- A. SHALL BE SCHEDULE 40 PVC PIPE WITH SOLVENT JOINTS. PITCH HORIZONTAL LINES 1" IN 10'-0". CONDENSATE DRAINS SHALL BE ROUTED TO FLOOR DRAIN OR INDIRECT WASTE DRAIN.
8. HVAC CONTROLS
- A. CONTRACTOR TO SUPPLY AND INSTALL ALL CONTROL WIRING AND THERMOSTATS AS REQUIRED.
9. ELECTRICAL
- A. CONTRACTOR TO COORDINATE WITH ELECTRICAL CONTRACTOR FOR LOCATION OF WIRING FOR EACH HVAC UNIT.
10. HANGERS & SUPPORTS
- A. ALL DUCTWORK SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE IN A NEAT AND WORKMANLIKE MANNER. SPACING OF DUCT SUPPORTS SHALL NOT EXCEED 10 FEET.

B. ALL PIPE SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE IN A NEAT AND WORKMANLIKE MANNER. THE USE OF WIRE OR METAL STRAP TO SUPPORT PIPES WILL NOT BE PERMITTED. SPACING OF PIPE SUPPORTS SHALL NOT EXCEED 8 FEET FOR ALL PIPING. PLASTIC PIPING TO BE SUPPORTED EVERY 4 FEET.
11. MISCELLANEOUS
- A. ALL EXTERIOR OPENINGS TO BE PROPERLY CAULKED AND SEALED WITH A SEALANT OF HIGH QUALITY AND LONG LIFE, TO PREVENT INFILTRATION OF OUTSIDE AIR INTO CONDITIONED SPACE.


























B. COORDINATE INSTALLATION OF ALL ROOF FLASHING AT ROOF PENETRATION.

C. DO NOT SCALE THIS DRAWING FOR EXACT DIMENSIONS. VERIFY ALL FIGURES, CONDITIONS, AND DIMENSIONS AT THE JOB SITE.

D. THE MECHANICAL PLANS ARE INTENDED TO BE DIAGRAMMATIC AND ARE BASED ON ONE MANUFACTURE'S EQUIPMENT. THEY ARE NOT INTENDED TO SHOW EVERY ITEM IN ITS EXACT LOCATION, THE EXACT DIMENSIONS, OR ALL THE DETAILS OF THE EQUIPMENT. THE CONTRACTOR SHALL VERIFY THE ACTUAL DIMENSIONS OF THE EQUIPMENT PROPOSED TO ENSURE THAT THE EQUIPMENT WILL FIT IN THE AVAILABLE SPACE.
12. TESTING AND BALANCING
- A. THE HVAC SYSTEM SHALL BE TESTED AND BALANCED BY AN INDEPENDENT AGENCY, UNDER THE SUPERVISION OF A LICENSED PROFESSIONAL ENGINEER. A SEALED TYPE WRITTEN REPORT SHALL BE SUBMITTED TO THE ARCHITECT/ENGINEER FOR REVIEW AND APPROVAL.
13. GUARANTEE
- A. MATERIALS, EQUIPMENT AND INSTALLATION SHALL BE GUARANTEED FOR A PERIOD OF ONE(1) YEAR FROM DATE OF ACCEPTANCE. DEFECTS WHICH APPEAR DURING THAT PERIOD SHALL BE CORRECTED AT THIS CONTRACTOR'S EXPENSE.

B. FOR THE SAME PERIOD, THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO PREMISES CAUSED BY DEFECTS IN WORKMANSHIP OR IN THE WORK OR EQUIPMENT FURNISHED AND/OR INSTALLED BY HIM.

MECHANICAL LEGEND

AP	ACCESS PANEL		S	STEAM SUPPLY
ACD	ACCESS DOOR		CDS	CONDENSER WATER SUPPLY
ADR	AUTOMATIC DAMPER		CDR	CONDENSER WATER RETURN
BDD	BACK DRAFT DAMPER		HS	HOT WATER HEATING SUPPLY
CS	CHILLED WATER SUPPLY		HR	HOT WATER HEATING RETURN
CR	CHILLED WATER RETURN		CS	CHILLED WATER SUPPLY
CD	CEILING DIFFUSER		CR	CHILLED WATER RETURN
DBR	DOWN BLOW REGISTER			GATE VALVE
DN	DOWN			CHECK VALVE
DL	DOOR LOUVER			RELIEF VALVE
EG	EXHAUST GRILLE			AUTOMATIC THREE-WAY VALVE
ER	EXHAUST REGISTER			GLOBE VALVE
EF	EXHAUST FAN			PRESSURE REDUCING VALVE
FDR	FIRE DAMPER			AUTOMATIC TWO-WAY VALVE
HS	HOT WATER HEATING SUPPLY			PLUG OR BALL VALVE
HR	HOT WATER HEATING RETURN			BALANCING VALVE
LID	LINEAR DIFFUSER			STRAINER
LAD	LOUVER/AUTO DAMPER			UNION
LMD	LOUVER/MANUAL DAMPER			THERMOSTAT
MVD	MANUAL VOLUME DAMPER			HUMIDISTAT
OAI	OUTSIDE AIR INTAKE			THERMOMETER
RG	RETURN GRILLE			PRESSURE GAUGE W/GAUGE COCK
RR	RETURN REGISTER			AUTOMATIC AIR VENT
SG	SUPPLY GRILLE			FLEXIBLE CONNECTION
SF	SUPPLY FAN			NEW CONNECTION TO EXISTING
SR	SUPPLY REGISTER			DUCT REDUCER
SD	SPLITTER DAMPER			
SC	STEAM COIL			
UNO	UNLESS NOTED OTHERWISE			
WMS	WIRE MESH SCREEN			





PACKAGED AIR CONDITIONING UNIT SCHEDULE										SYMBOL	AC					
NO.	COOL CAPY. MBH	HEAT CAPY. MBH	CFM	ESP.	H.P.	O.A. CFM (MIN.)	ELECTRICAL			REMARKS						
							VOLTS	PHASE	HERTZ							
1	90.0	120.0	3000	.5	2	150	208	3	60	CARRIER 48TCEA08	1	2	3	4	5	6
2	90.0	120.0	3000	.5	2	150	208	3	60	CARRIER 48TCEA08	1	2	3	4	5	6
2	90.0	120.0	3000	.5	2	150	208	3	60	CARRIER 48TCEA08	1	2	3	4	5	6


-  PROVIDE ROOF CURB
-  PROVIDE GAS FIRED HEATING
-  PROVIDE ECONOMIZER WITH BUILT-IN RELIEF
-  PROVIDE PROGRAMMABLE THERMOSTAT
-  PROVIDE HOT GAS REHEAT OPTION
-  PROVIDE SMOKE DETECTOR

ELECTRIC HEATER SCHEDULE							SYMBOL	<div><div>EH</div></div>
NO.	HEATING CAPACITY KW	TYPE	ELECTRICAL			MANUFACTURER MODEL NUMBER	REMARKS	
			VOLTS	PHASE	HERTZ			
1	2.0	WALL HEATER	208	1	60	QMARK SERIES AWH	<div>1</div>	
<div><div>1</div> WITH INTERGAL VANDAL PROOF THERMOSTAT</div>								

SUPPLY/EXHAUST FAN SCHEDULE							SYMBOL	
							EF	SF
NO.	CFM	S.P.	RPM	H.P.	TYPE	REMARKS		
1	6400	1.5			ROOF MOUNTED UP BLAST KITCHEN HOOD	EXISTING FAN TO BE REUSED / RELOCATED PROVIDE NEW ROOF CURB		
2	8000	1.5			ROOF MOUNTED UP BLAST KITCHEN HOOD	EXISTING FAN TO BE REUSED / RELOCATED PROVIDE NEW ROOF CURB		
3	5585	.5			ROOF MOUNTED FILTERED KITCHEN SUPPLY	EXISTING FAN TO BE REUSED / RELOCATED PROVIDE NEW ROOF CURB		
4	6865	.5			ROOF MOUNTED FILTERED KITCHEN SUPPLY	EXISTING FAN TO BE REUSED / RELOCATED PROVIDE NEW ROOF CURB		
5	370	.375	1200	150 WATTS	IN LINE CENTRIFUGAL	COOK GN-520		

DIFFUSER SCHEDULE									SYMBOL 
MARK	CFM RANGE	SUPPLY RETURN EXHAUST	TYPE	SIZE		MAX. S.P. IN W.G.	MAX. N.C.	MANUFACTURER MODEL NUMBER	
				FACE	NECK				
1	0 – 150	S	LAY-IN	24X24	6"ø	0.08	20	TITUS OMNI	
2	151-250	S	LAY-IN	24X24	8"ø	0.08	20	TITUS OMNI	
3	251-380	S	LAY-IN	24X24	10"ø	0.08	20	TITUS OMNI	
4	381-650	S	LAY-IN	24X24	12"ø	0.08	20	TITUS OMNI	

RETURN GRILLE SCHEDULE									SYMBOL 
MARK	CFM RANGE	SUPPLY RETURN EXHAUST	TYPE	SIZE		MAX. S.P. IN W.G.	MAX. N.C.	MANUFACTURER MODEL NUMBER	
				FACE	NECK				
1	0-1800	R	SURFACE	22X22	20X20	0.08	20	TITUS SERIES 500	

EXHAUST REGISTER SCHEDULE									SYMBOL 
MARK	CFM RANGE	SUPPLY RETURN EXHAUST	TYPE	SIZE		MAX. S.P. IN W.G.	MAX. N.C.	MANUFACTURER MODEL NUMBER	
				FACE	NECK				
1	0 – 120	E	SURFACE	12X12	6"ø	0.08	20	TITUS SERIES 500	
2	121-250	E	SURFACE	12X12	8"ø	0.08	20	TITUS SERIES 500	

KITCHEN AIR BALANCE

EXHAUST		MAKEUP AIR	
EF-1	6400	SF-3	5585
EF-2	8000	SF-4	6865
EF-3	370	RTU-1	650
		RTU-2	650
		RTU-3	650
14400		14400	


KITCHEN EXHAUST DUCT NOTES:

- KITCHEN EXHAUST DUCTS TO BE 16 GAUGE SHEET METAL WITH ALL DUCT CONNECTIONS, EXTERNAL JOINTS AND SEAMS WELDED LIQUID TIGHT IN ACCORDANCE WITH NFPA 96, IMC AND ALL LOCAL CODES.
- ALL ELBOWS SHALL BE FULL RADIUS ROUND TYPE WITH NO SQUARE ELBOWS, TURNING VANES OR VOLUME DAMPERS.
- PROVIDE CLEANOUTS A MINIMUM OF 20" PER NFPA, IMC AND ALL LOCAL CODES.
- DUCTWORK TO BE INSTALLED A MINIMUM OF 18" FROM ALL COMBUSTIBLES, IF 18" CANNOT BE MAINTAINED, PROVIDE INSULATION IN ACCORDANCE WITH NFPA.
- SLOPE ALL HORIZONTAL DUCTS TOWARDS HOOD OR COLLECTION POINTS PER NFPA, IMC AND ALL LOCAL CODES.


MECHANICAL SHEET NOTES:

- SUPPLY/RETURN DUCT UP THRU ROOF TO UNIT WITH 6" FLEXIBLE CONNECTION, DUCT TO BE FULL SIZE OF UNIT OPENING.
- EXISTING EXHAUST DUCT AND LOUVER TO REMAIN. BLANK OFF EXISTING DUCT AS SHOWN ON PLANS
- CONNECT EXHAUST DUCT TO HOOD PER HOOD MANUFACTURES REQUIREMENTS.
- CONNECT MAKE-UP AIR DUCT TO HOOD PER HOOD MANUFACTURES REQUIREMENTS.
- CONNECT EXHAUST DUCT TO EXISTING EXHAUST DUCT.


1
DETAIL - CONTOURED TEE TAP BRANCH DUCT
TAKE - OFF
NOT TO SCALE

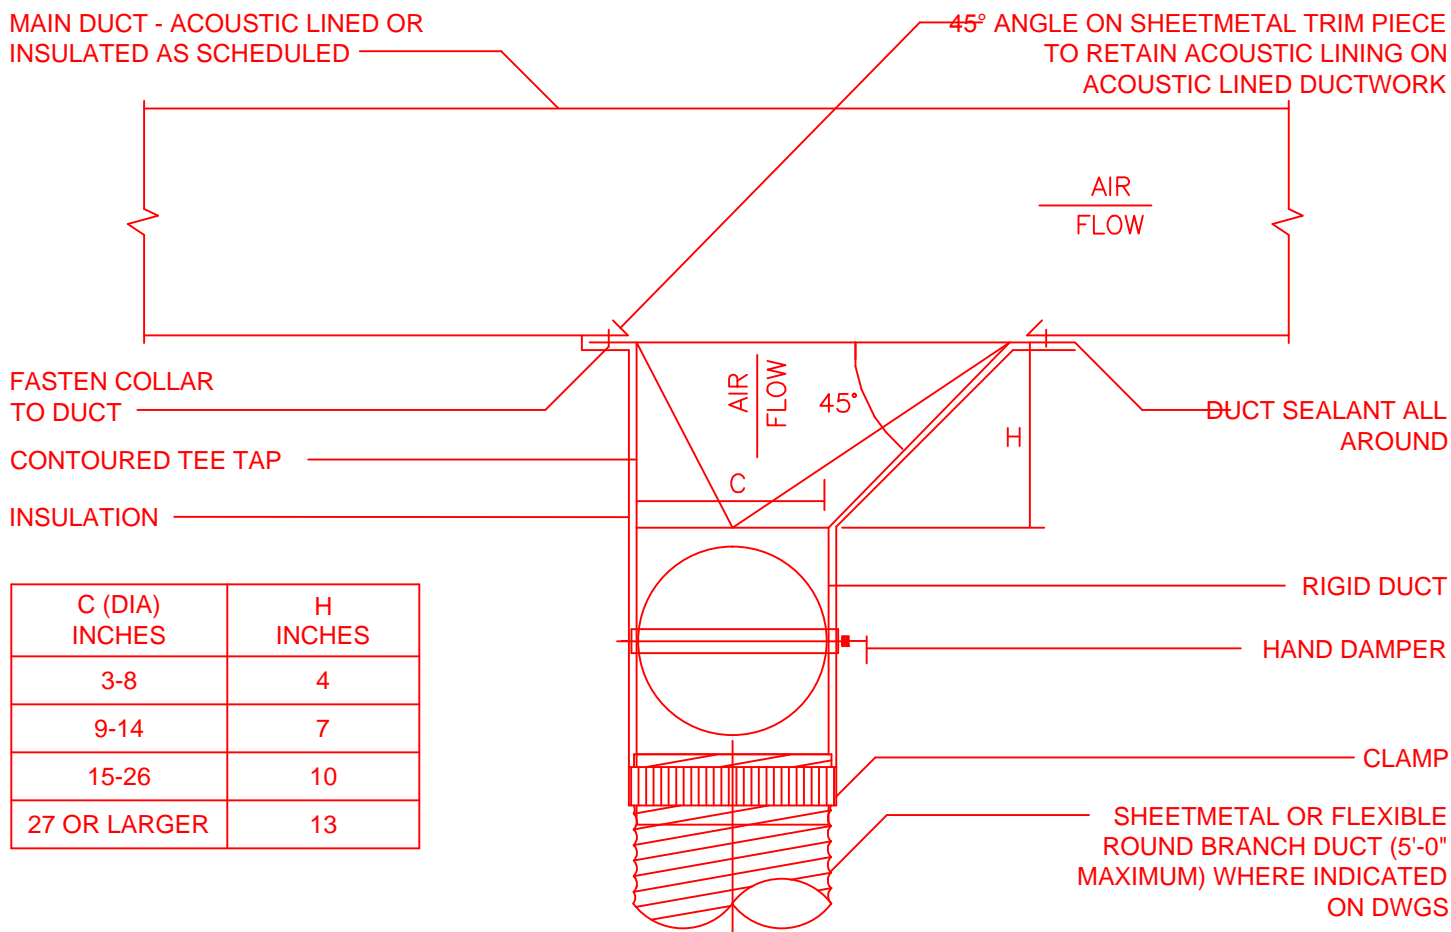

NOTE: NO FLEX DUCT ALLOWED IN AREAS OF EXPOSED DUCTWORK

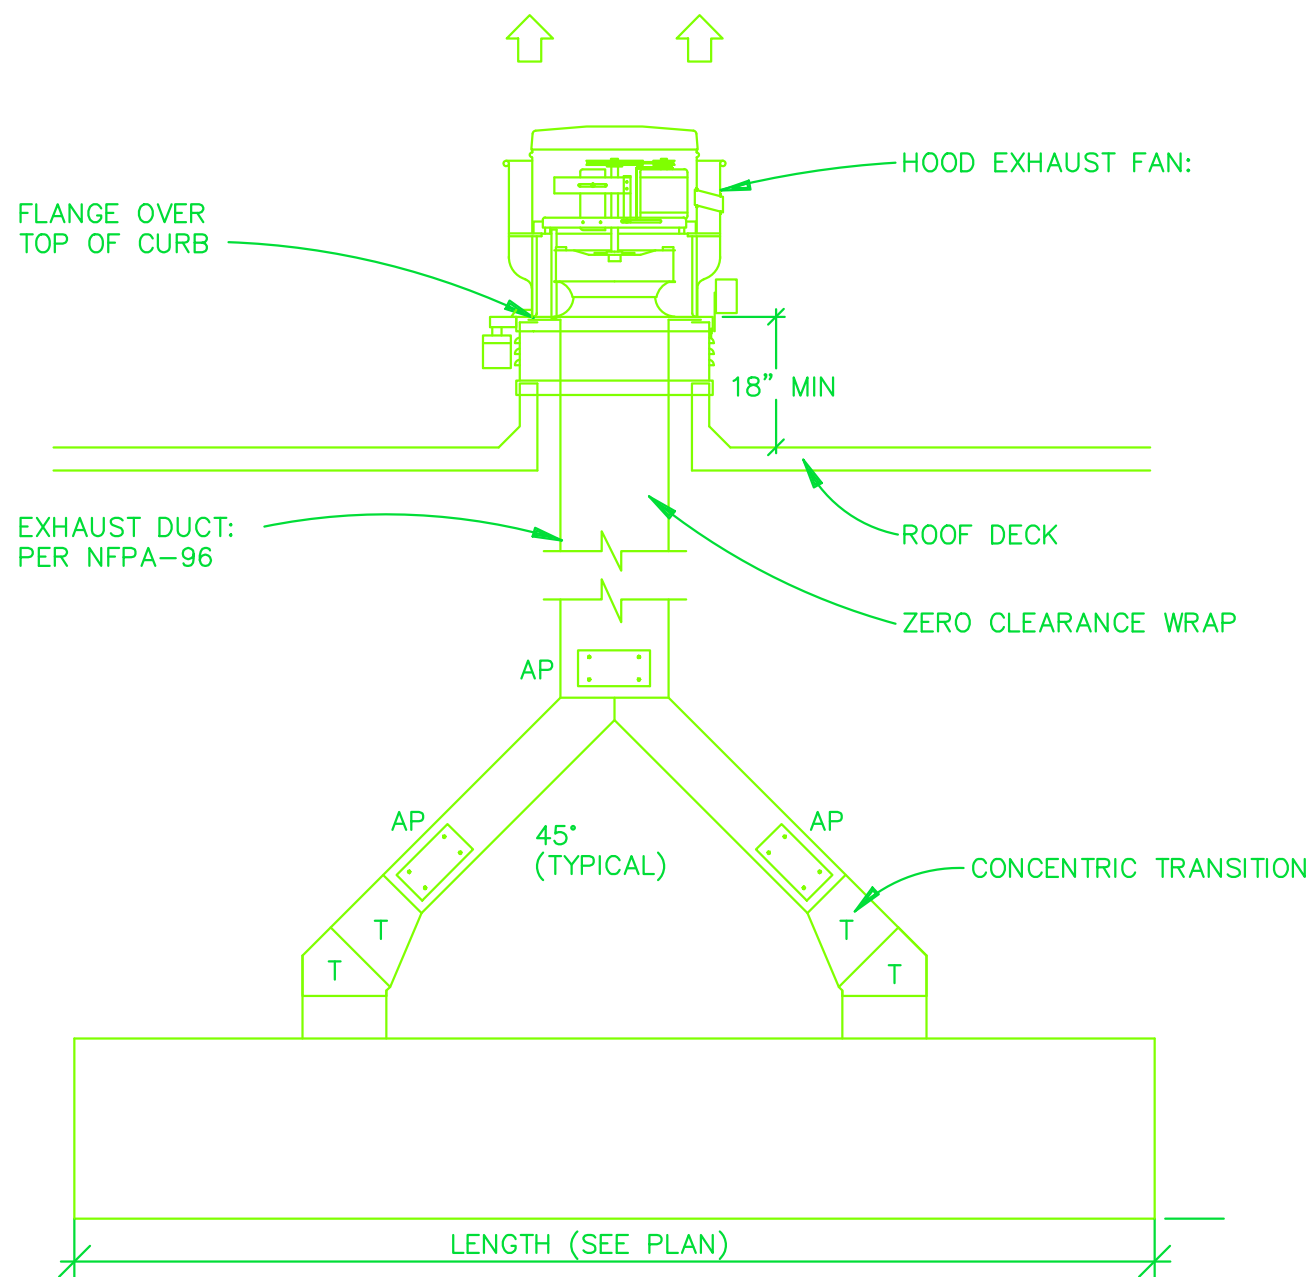

GREASE EXHAUST DUCT DETAIL
NO SCALE

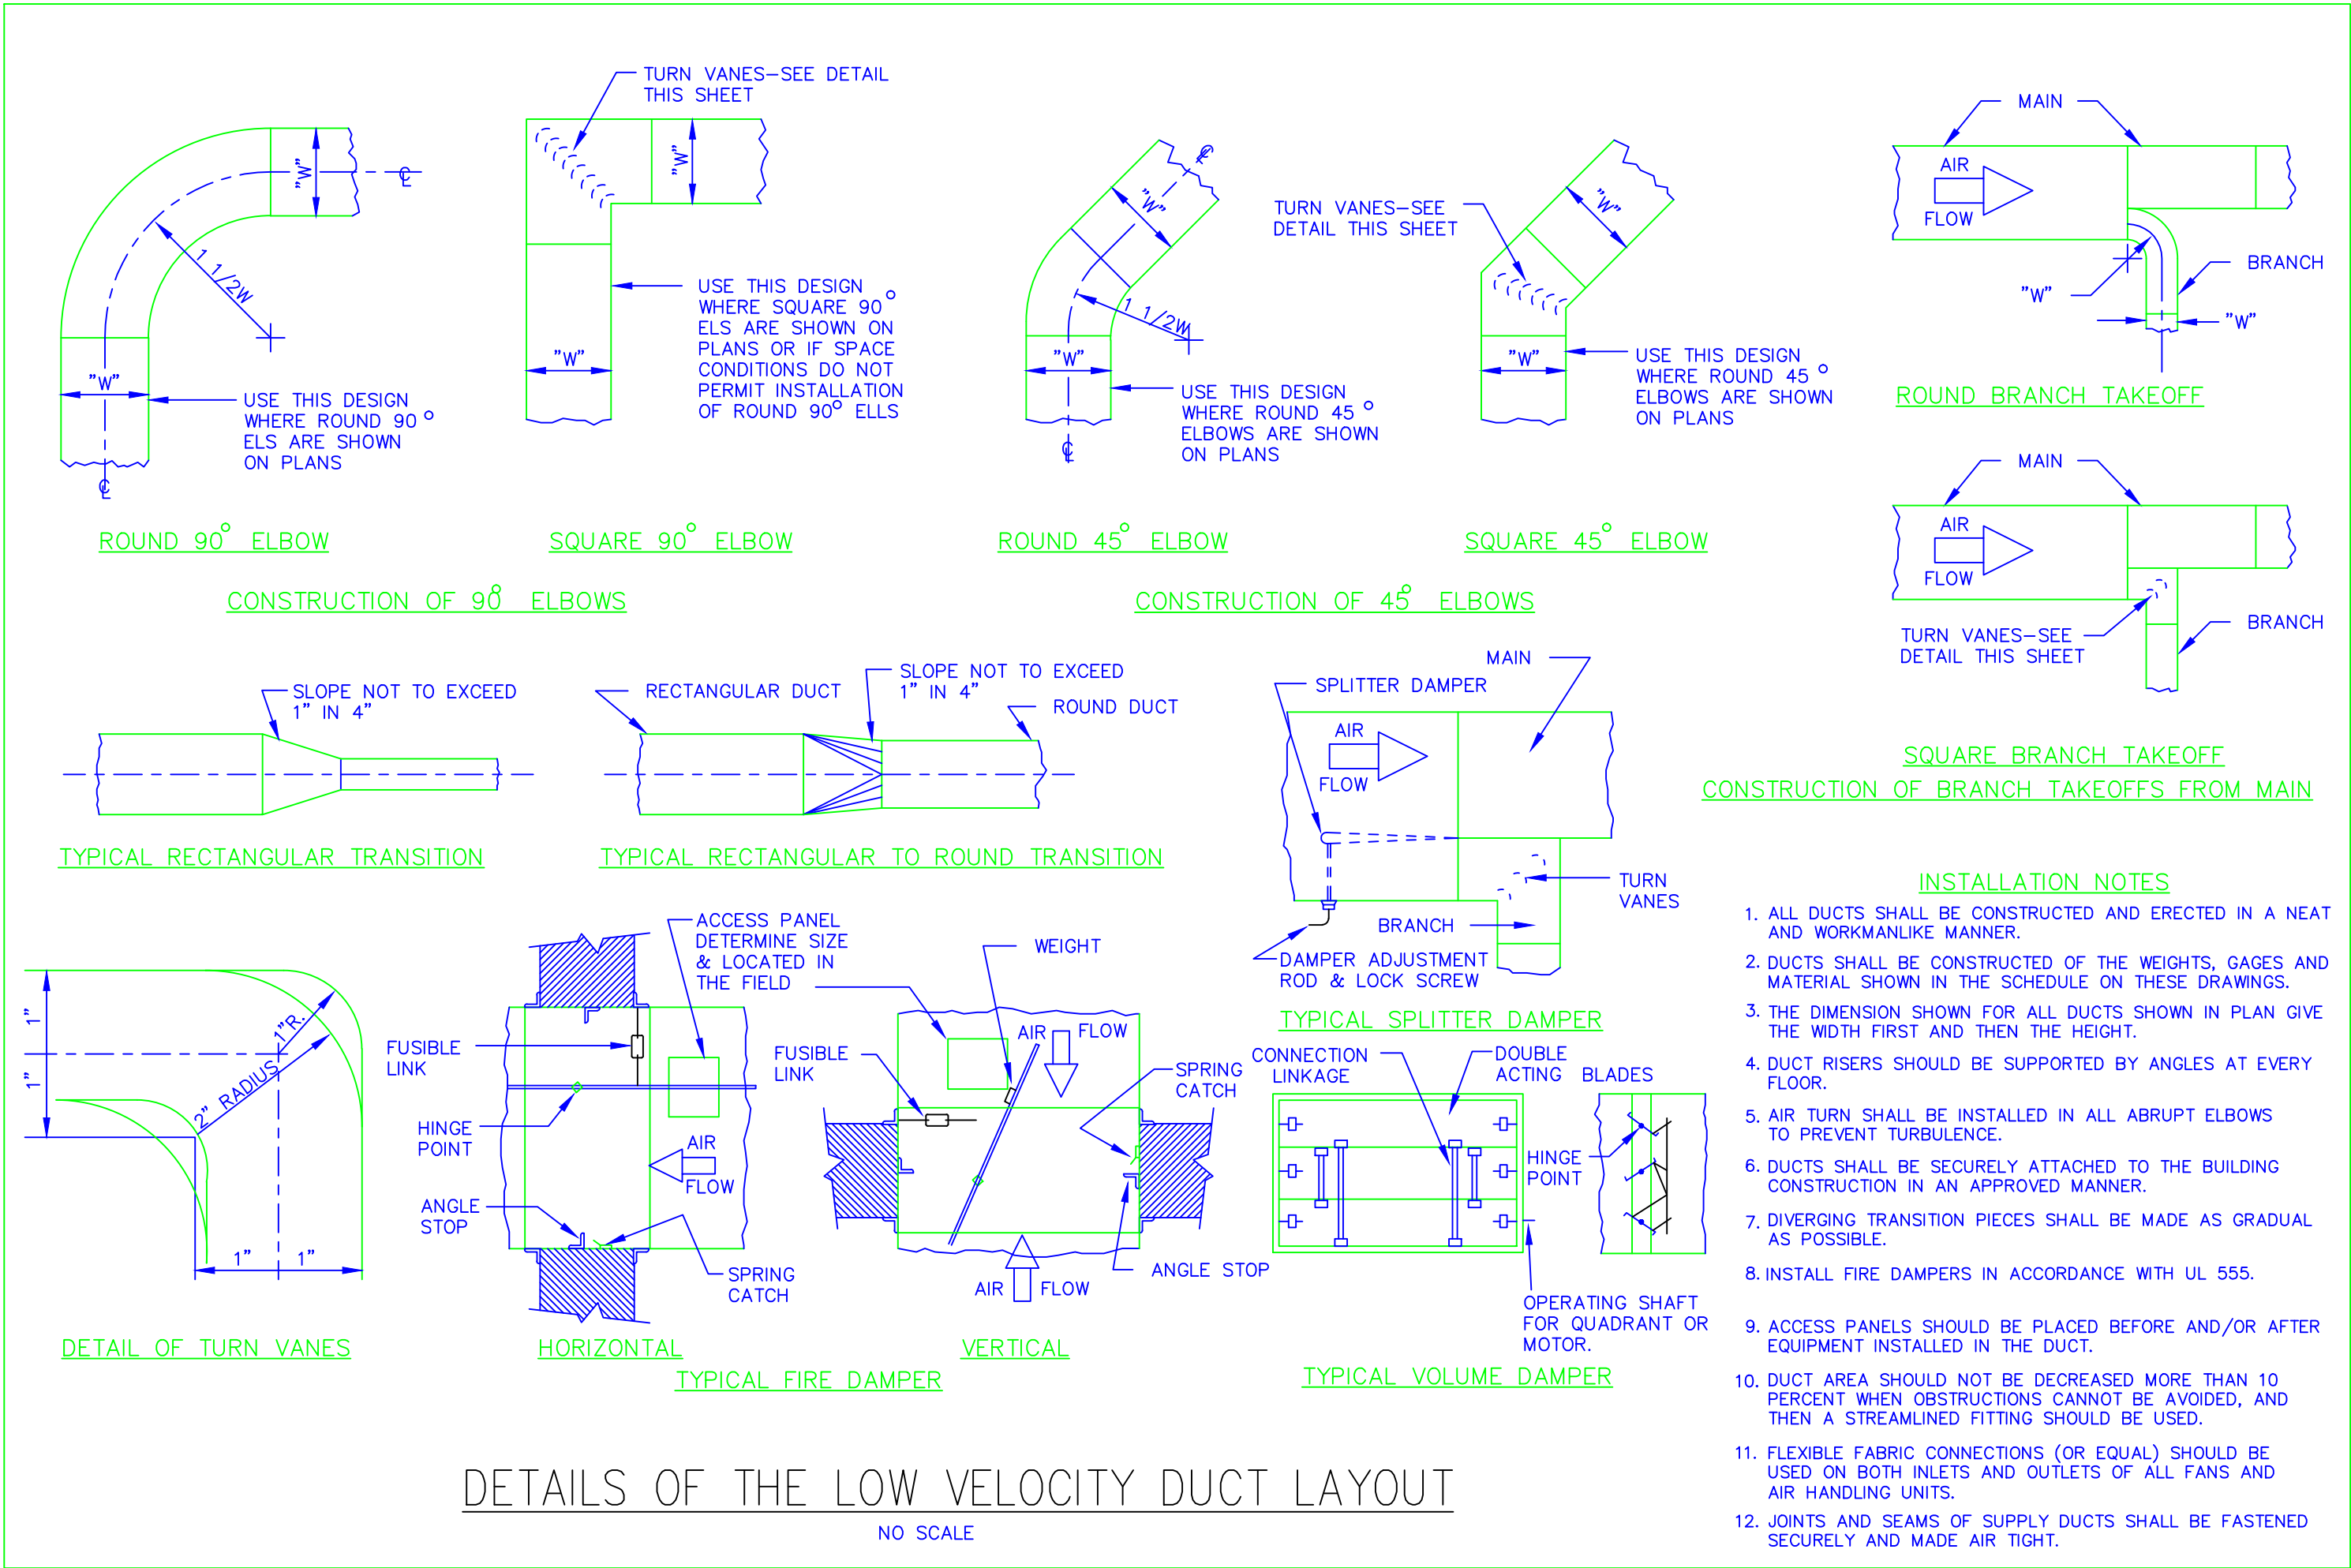

DUCT CONSTRUCTION MINIMUM SHEET METAL THICKNESSES			
RECTANGULAR DUCTS			
MAXIMUM SIZE (INCHES)	STEEL (MINIMUM THICKNESS, NOMINAL)		ALUMINUM (MINIMUM THICKNESS, NOMINAL)
THROUGH 12	0.022 INCH (26 GAGE, GALV.)		0.020 INCH (NO. 24 B&S GAGE)
13 THROUGH 30	0.028 INCH (24 GAGE, GALV.)		0.025 INCH (NO. 22 B&S GAGE)
31 THROUGH 54	0.034 INCH (22 GAGE, GALV.)		0.032 INCH (NO. 20 B&S GAGE)
55 THROUGH 84	0.040 INCH (20 GAGE, GALV.)		0.040 INCH (NO. 18 B&S GAGE)
OVER 84	0.052 INCH (18 GAGE, GALV.)		0.051 INCH (NO. 16 B&S GAGE)
ROUND DUCTS			
MAXIMUM SIZE (INCHES)	SPIRAL SEAM DUCT	LONGITUDINAL SEAM DUCT	FITTINGS
	STEEL (MINIMUM THICKNESS, NOMINAL)	STEEL (MINIMUM THICKNESS, NOMINAL)	STEEL (MINIMUM THICKNESS, NOMINAL)
THROUGH 12	0.019 INCH (28 GAGE, GALV.)	0.022 INCH (26 GAGE, GALV.)	0.022 INCH (26 GAGE, GALV.)
13 THROUGH 18	0.022 INCH (26 GAGE, GALV.)	0.028 INCH (24 GAGE, GALV.)	0.028 INCH (24 GAGE, GALV.)
19 THROUGH 28	0.028 INCH (24 GAGE, GALV.)	0.034 INCH (22 GAGE, GALV.)	0.034 INCH (22 GAGE, GALV.)
29 THROUGH 36	0.034 INCH (22 GAGE, GALV.)	0.040 INCH (20 GAGE, GALV.)	0.040 INCH (20 GAGE, GALV.)
37 THROUGH 52	0.040 INCH (20 GAGE, GALV.)	0.052 INCH (18 GAGE, GALV.)	0.052 INCH (18 GAGE, GALV.)